

**NASPI Control Room Solutions Task Team
Breakout Session – Philadelphia, PA
Presenters: Mike Cassiadoro & Jim Kleitsch
October 23, 2018**



Agenda

- I. Introductions
- II. Conduct joint panel session with PRSVTT on Use of Synchronphasor Technology for Enhanced State Estimation
- III. Review action items from September 2018 call
- IV. Provide update on Disturbance Detection document
- V. Address recurring request for:
 - Focus Area Documents
 - Video Event Data
 - Use Case Document Ideas
- VI. Discuss Use of Time-Synchronized Measurements in Real-time Ops Horizon training course
- VII. Adjourn

CRSTT Sept. 2018 Meeting Minutes

Action Items


- **All:** please register for the NASPI Work Group meeting if you plan on attending. Learn more [here!](#)
- **Jim K.:** will reach out to Ryan regarding current CIP information/presentation that can be shared with the CRSTT during the breakout session.
- **Mike C:** will contact SCE, SDG&E and others to determine interest in developing operational use case addressing the use of synchrophasor data to monitor synchronous devices.

New Business

- Total Reliability Solutions will be collaborating with PNNL to develop a Use of Time-Synchronized Measurements in the Real-time Ops Horizon training course. The base materials will be made available to the public upon completion. Intended audience is RC, BA, and TOP System Operators tasked with monitoring and controlling the Bulk Electric System. “Train the Trainer” class will be held at PNNL in February 2019. Eric Andersen (eric.andersen@pnnl.gov) is PNNL’s point-of-contact. More details can be found in today’s agenda.

Focus Area Doc on Disturbance Detection

CRSTT to review and discuss latest draft of *Use of Synchrophasor Data to Determine Disturbance Location* focus area document.

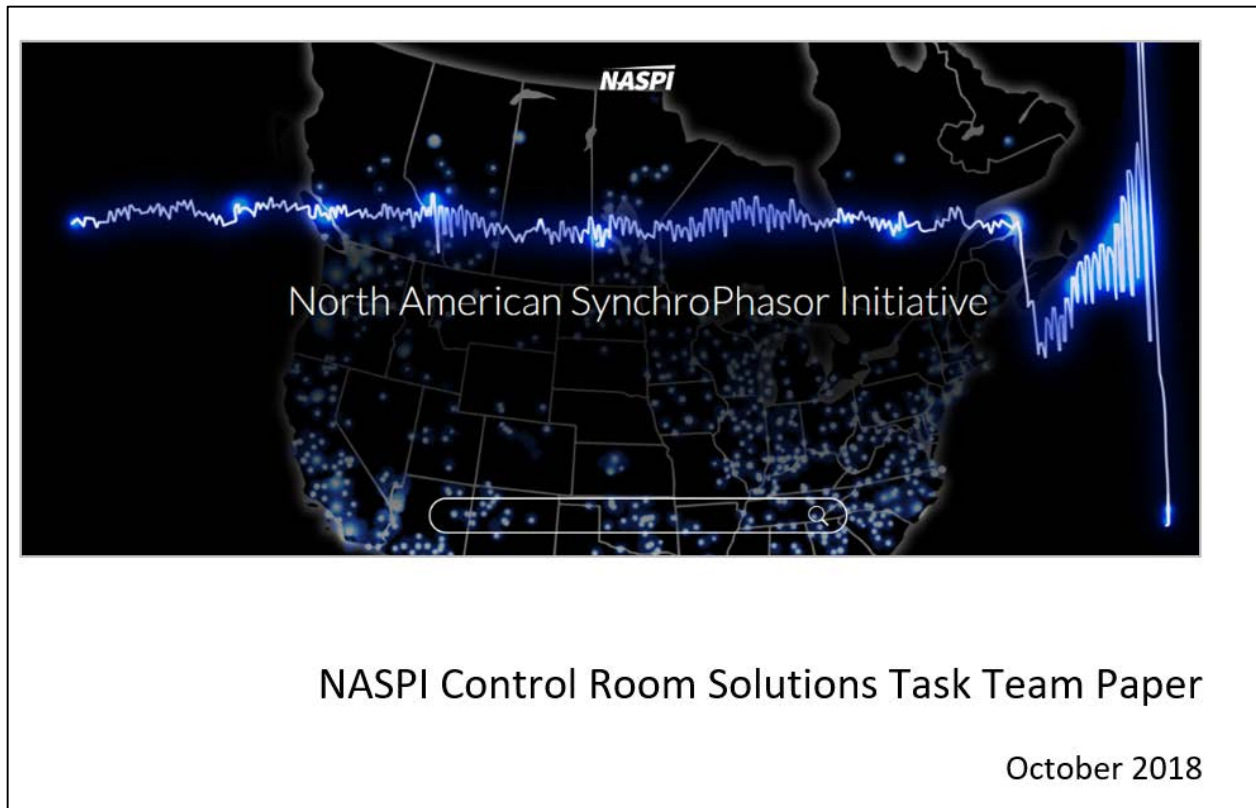

Focus Area Documents


Using Synchrophasor Data to Monitor Reactive Power Balancing

➤ (Cassiadoro -TRIS, Peak RC –Zhang, Vaiman –V&R Energy)

❑ No significant progress to date

Video Event Files

Objective – Continue building library of events to demonstrate value PMU data provides when analyzing abnormal events and disturbances.

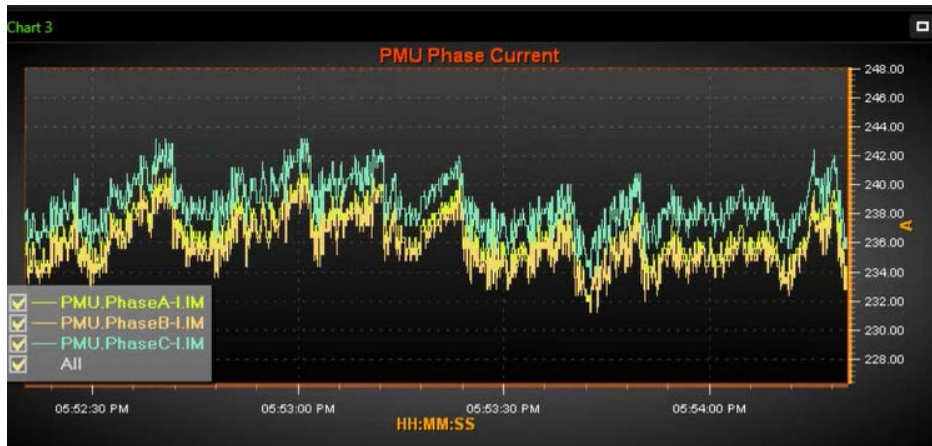

Video

PMU versus SCADA Video Events [Summary](#). Please refer to EPG's [template](#) and the [Synchrophasor Data File Format .CSV](#) when creating a video event.

Video 1 - Current and voltage oscillations observed on the 138 kV system during testing of new generator controls (65 MW gas turbine).

[RTDMS PMU vs. SCADA Video 1](#)

Video 2 - Voltage oscillations observed on the 230 kV system when a water pump was taken offline.

[RTDMS PMU vs. SCADA Video 2](#)

Video 3 - Voltage oscillations observed following the loss of a 345 kV line during a period of high wind generation.

[RTDMS PMU vs. SCADA Video 3](#)

Video 4 - Real and Reactive Power oscillations observed on the 69 kV system during a period of high wind generation with the plant radially connected (i.e. one of two normal source lines out of service).

[RTDMS PMU vs. SCADA Video 4](#)

Video 5 - Real and Reactive Power oscillations observed during a period of high wind generation.

[RTDMS PMU vs. SCADA Video 5](#)

Video 6 - Real Power and voltage oscillations observed following the loss of a large generator.

[RTDMS PMU vs. SCADA Video 6](#)

Video 7 - Wind farm Oscillation Detection and Mitigation using Synchrophasor Technology

[Wind Farm Oscillation Detection and Mitigation](#)

Video 8 - A 230kV fault followed by a loss of a large generation plant caused system frequency to drop approximately 72mHz momentarily, while having an impact on nearby system voltages and online generators ([Clip 1](#) , [Clip 2](#) , [Clip 3](#))

[Video 9](#) - Please be patient with the download, the video is very large. This video captures the actual synchronization of a large generator to the electric grid. The windows in the visualization tool capture frequency, output power, voltage angle, and voltage magnitude of the generator and at a reference point on the electric grid.

Use Case Documents

Objective – Develop docs that demonstrate ways that grid operators and electric utilities are using synchrophasor data to provide operational value.

Event ID	Event	Event Category	Entities Involved	Event Description	Extended Description in Related NASPI Technical Paper	Safety Impact	Reliability Impact	Budgetary Impact
TE02	Failing potential transformer	Transmission Equipment	ATC	Abnormal voltage signature found while reviewing PMU data led to discovery of a failing potential transformer which was subsequently isolated and replaced.	p.38	The utility avoided safety risk to personnel that might have been in close proximity to the PT during its failure.		Utility avoided costs associated with customer minutes of interruption that would have resulted from the potential transformer's failure had the condition not been identified and a mobile transformer placed in service to facilitate the outages necessary for its replacement.
TE03	Loose connections in potential circuits	Transmission Equipment	OG&E	Fluctuations observed in positive sequence voltage data collected from PMUs led to discovery of a loose fuse connection in a CCVT safety switch. PMU data has been used in a similar fashion to reveal faulty terminations, animal-damaged conductor and contact corrosion.	p.40			Utility avoided costs associated with equipment damage and customer minutes of interruption that might have resulted had the issues not been addressed.

Synchrophasor Training Course

TRS and PNNL are collaborating to develop a *Use of Time-Synchronized Measurements in the Real-time Ops Horizon* training course. The base materials will be made available to the public upon completion.

Course Length: 8 Hours (8 CEH)

Intended Audience: RC, BA and TOP System Operators tasked with monitoring and controlling the Bulk Electric System.

Training Goals:

1. Increase knowledge and advance use of synchrophasor technology by creating training materials that grid operators and electric utilities can integrate into their respective training programs.
2. Provide train-the-trainer workshops to help electric industry trainers meet the underlying knowledge requirements before delivering company-specific training on the topic.

Synchrophasor Training Course (Cont.)

Are PNNL and TRS in search of industry partners to assist with the design and development of training materials?

Yes, all grid operators and electric utilities that wish to participate in the design and development of course materials are invited to do so. Those that do will be invited to attend a “train-the-trainer” session at PNNL free of charge (entities responsible for travel costs only).

Who has agreed to participate so far?

ERCOT, ISO-NE, SCE and WAPA have tentatively agreed to support this work effort. Invites are outstanding to BPA, CAISO, Peak Reliability, PJM and SDG&E.

What’s the timeline for course development?

PNNL & TRS expect to finalize the training outline in Nov.2018, complete the course materials in Jan. 2019, and hold the “train-the-trainer” class in Feb. 2019.

Please contact Mike Cassiadoro (mcassiadoro@totalreliabilitysolutions.com) or Eric Andersen (Eric.Andersen@pnnl.gov) if you’re interested in participating!

CRSTT – Primary Contacts

Name: Michael Cassiadoro

Email: mcassiadoro@totalreliabilitysolutions.com

Phone: 360-836-9008

Name: Jim Kleitsch

Email: jkleitsch@atcllc.com

Phone: 608-877-8102

Next NASPI CRSTT Conference Call: November 21, 2018

Next NASPI WG Meeting: April 2019 in San Diego, CA